



FRONT VIEW

SIDE VIEW

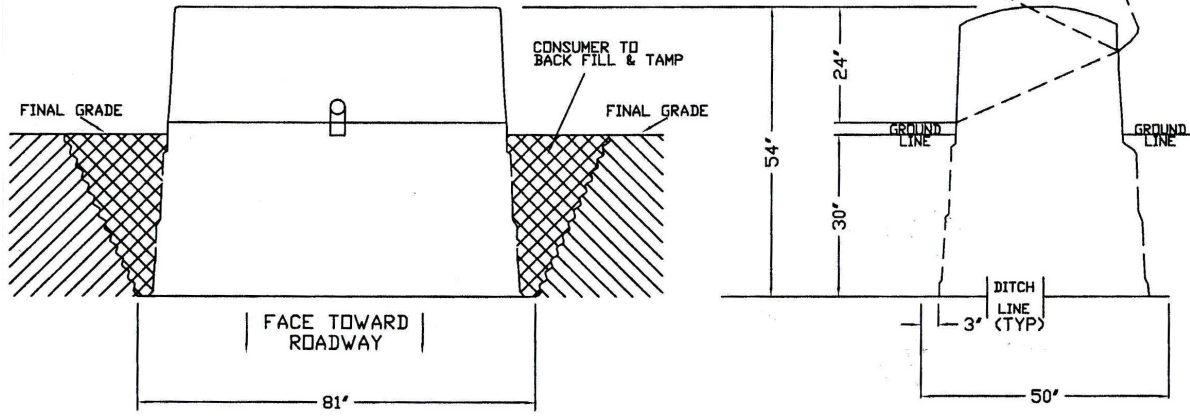

MINIMUM EXCAVATION REQUIREMENTS

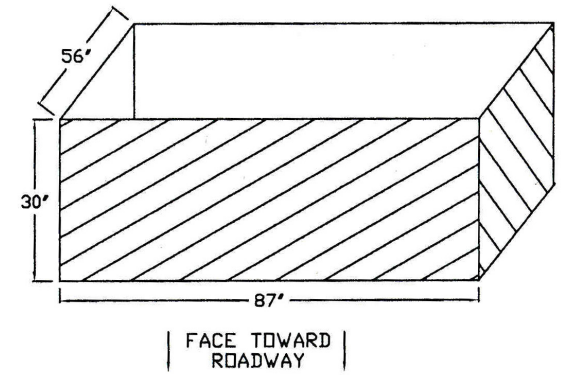

TWO OR THREE PHASE ENCLOSURE



**CENTRAL
VIRGINIA
ELECTRIC
COOPERATIVE**

11/25/02